

# Energy Use

Fire Station 8

4845 Lee Highway

This building uses

# 26%

**LESS ENERGY**

than the average  
Arlington County Government  
(ACG) fire station

**AVG. ACG FIRE STATION USE**

## 116.2


**THIS BUILDING**

## 85.4

Energy use is measured in kBtu/sq. ft.

**ARLINGTON  
2050 TARGET**

## 37.2

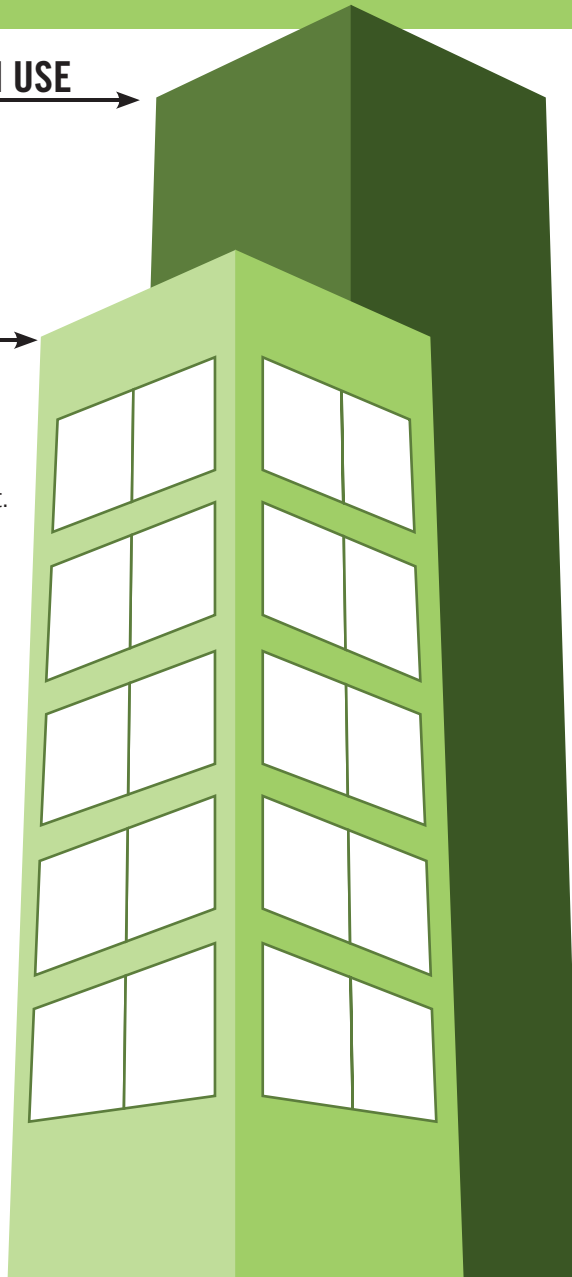

*Size of buildings is not to scale. Data from 2013.*

## CARBON FOOTPRINT



## 18.8

This building



## 26.2

Average  
ACG fire station

Carbon footprint is measured in pounds of carbon dioxide equivalent (CO<sub>2</sub>e/sq. ft.).

### BUILDING FACTS

- **Building Use:** Public Safety
- **Built:** 1963
- **2009:** Lighting Retrofit

